NLAR SUBMITTAL DATA SKU: D1030-D-FBO-G

30" PRE-ENGINEERED RANGE HOOD

BASE MODEL: D1030-D-FBO

Job Name:	Date:		Mark:
Reference:	Unit Location:		Prepared By:
Engineer:	Contractor:		Approval:
Expected Job Date:	Notes:_		
MODEL FAN OPTIONS Integral Fans: F - Recirculating R - Disch	orging		
Top Discharging External Fans: X FBO - Fan by	8 8	Fan 🗌 BE - Boof Moi	inted Fan 🗌 WE - Wall Mounted Fan
SELECT OPTIONAL ACCESSORIES			
ADA: ADA Fan/Light Control		MACM: Make-Up	Air Control Module
CLBX: ClockBox		CLBX-PRO: Clock	Box Pro with integrated ADA
CC: Custom Color – (Stainless Standard) Specify Color:	STROBE: Horn and	d Light Strobe Alarm
TANK-TEST: Test Tank		CFCS: Common Fa	an Control
MPK: Manual Pull Station		PD4X: Power Distr	ibution Box
D1030-TC-D: Top Cover			
RANGE FUEL SOURCE DISCONNECT OPTI			
G: 3/4" NPT Natural Gas (DED Needed i to be Controlled on a Gas Range)	r Electric Components Need		t (includes 3/4" NPT Natural Gas and Electric) - 20VAC O 5-20R, 120VAC
E: Electric -		DRD: Dual Recepta	,
O 14-50R, 220VAC O 6-20R, 22	NVAC		20VAC O 5-15R, 120VAC O 5-20R, 120VAC
O 10-50R, 220VAC O 5-20R, 120			
O 5-15R, 120VAC			
ELECTRIC NEMA (RECEPTACLE) OPTIONS	5		
	0-50R 6-20R 6-20R 220VAC 20AM	5-15R P 120VAC 15AMP	5-20R 120VAC_20AMP
	C JUAINII ZZUVAC ZUAIN		ntact factory for any special circumstances
REQUIREMENTS			inter including for any special circuits directs

Hood shall:

- Be D1000 Series by DENLAR Fire Protection
- Be wall mounted so that the bottom of the mounting bracket sits 24" to 30" above the range
- Be of stainless-steel construction (#18 & #20 GA, polished 304) with no sharp edges and brushed finish
- Have factory installed fire suppression system
- Have 212° F degree fusible link (30") which will activate the mechanical fire suppression system
- Have wet chemical extinguishing agent: Low PH Amerex
 660 (pressurized potassium citrate / potassium acetate mix)
- Fan by others must have centrifugal fan with air delivery



- Be ETL listed, tested to UL300A standard
- Fan by others motor shall be permanently lubricated and meet UL507 standard
- CFM should achieve at least 500CFM for compliance
- Include a power disconnect for gas and/or electric appliances, deactivated at suppression system discharge
- Automatically disconnect range element once a certain preset temperature is reached or under particular predefined events or conditions
- Unit shall have multiple alarm contacts pre-installed (local, remote and trouble alarms) and an audible buzzer









DL1221A 3/24

FIRE PROTECTION

BASE MODEL: D1030-D-FB0



GENERAL FEATURES

- ETL/CSA listed
- 304 Brushed Stainless Steel
- Fail-Safe mechanical actuation
- Two step pre-suppression
- Plenum nozzle
- Main power switch and reset switch
- Service switch

UNIT DIMENSIONS

Pressure switch Pressure gauge

- Temperature switches
- Hard wired fuel source disconnect
- Dry alarm contacts
- On board diagnostics
- Status LED

- Trouble signal
- Service key
- Audible buzzer (90db)

53.4 lbs


LED bulb

SPECIFICATIONS


Compliance Weight

Grease baffle with drip tray

UL300A, NSF, UL507

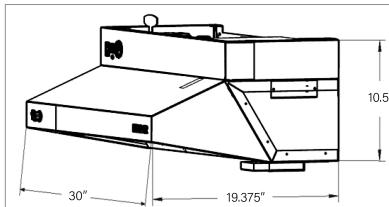


REQUIRED FOR ALL MODELS

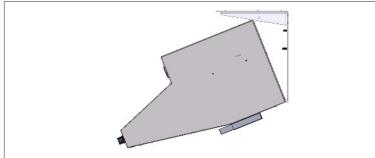

The main unit requires clearance to tilt to a 45° degree angle for maintenance purposes





	0011100	
Mounting Configuration	Wall	
Min / Max Install Height Above Top of Residentail Range / Cook Top	24" - 30"	
Voltage	120 AC	
Phase	1	
Hz	60 Hz	
Amps	1 Amps	
Circuit reaker size	15-20 Amps	
Operating Current	.75 Amps	
Fan Operating Current	N//A	
Output Operating Current	0.25 to 0.5 Amps	
Input Wiring	Power Cord	
Output Wiring	14/2 MC Wire	
Fan Type	Fan By Others / 3rd Party Supplies Fan (Fan is External)	
МОСР	15 Amps	
Duct Type	See Local Codes	
Fire Control	Programmable Logic Controller	
Tank Type	Stainless Steel	
Tank Pressure	102+-8% Psi	
Tank Volume	1300 mL	
Suppression Agent	Low pH Wet Chemical Amerex 660	
No. of Nozzles / Spray	5 / 60 Degree Conical	
Protection Device / Limit	3 Globe Links / 212° F	









BASE MODEL: D1030-D-FBO

NOZZLE PLACEMENT

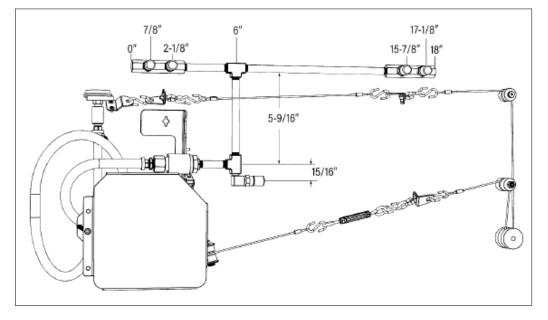

TOP DUCTED EXHAUST

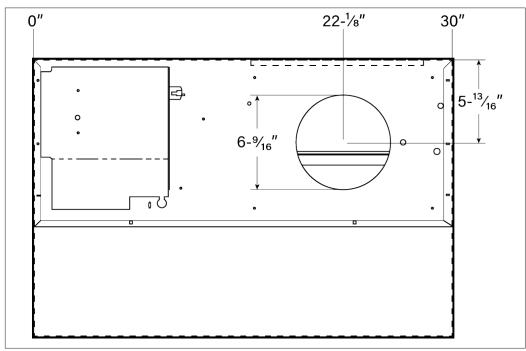






GAS POWER SOURCE DISCONNECT: -G (D1000)


GAS VALVE DIMENSIONS

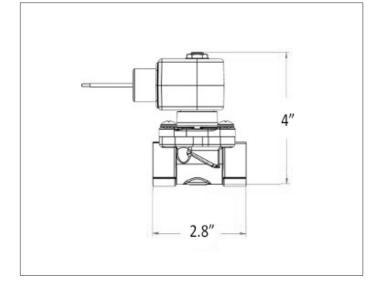

SPECIFICATIONS

Model	D1000-G		
Coil Voltage	120 AC		
Phase	1		
Frequency	60 Hz		
Fuse	0.5 Amps		
Operating Current	0.25 Amps		
Valve Type	2-way		
Function	Normally closed		
Actuation Type	Direct lift		
Coil Type	1⁄2″ Npt conduit, 18′ leads, class F, NEMA 4X		
Body Material	Brass		
Seal Material	NBR		
Orifice Size	7/16"		
Port Size	3/4"		
Number Of Ports	2		
Port Type	NPT		
Media	General purpose for air, liquids, and gases		
Min. Pressure Differential	0 PSI		
Max. Pressure Differential	100 PSI (AC)		
Min. Fluid Temperature	0° F		
Max. Fluid Temperature	185° F		
Flow Coefficient	5 CV		

SCHEMATIC

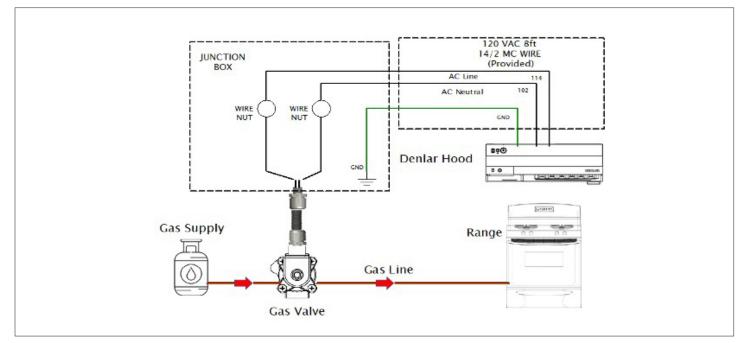






FAN: -FBO (D1000) 30"


SCHEMATIC

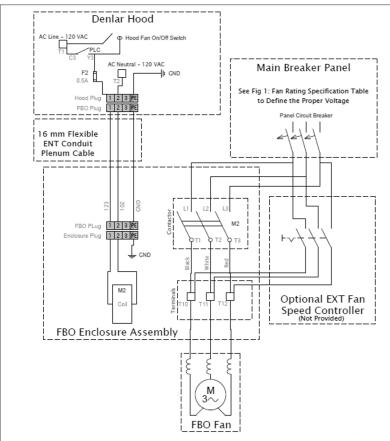

SPECIFICATIONS

Style	N/A
Туре	3rd party supplied
Weight	6.4 lbs.
Operating Current	0.25 Amps
Voltage	120 AC
Phase	1
Frequency	60 Hz
CFM + -2.5% (Low-High)	N/A
Pressure (In Water)	N/A
dBA (Low-High)	N/A
Hood Outlet (Low-High)	N/A
Duct	N/A
Fan Inlet	N/A
Fan Outlet	N/A
Control	ON/OFF
Speeds	Single Speed
Fuse	0.5 Amps
Fuse Type	5 mm x 20 mm
Mounting Configuration	Surface Mount or Flush Mount

UNIT DIMENSIONS

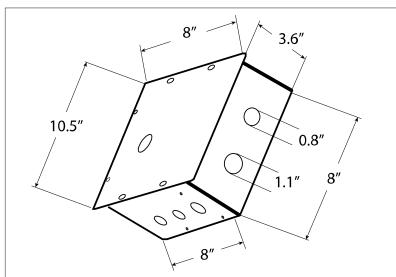





Fan Rating Specification			
Phase	Voltage	HP	Amps
1 PH	120	2	24
1 PH	240	3	17
3 PH	200 - 208	7.5	25.3
3 PH	220 - 240	7.5	22
3 PH	440 - 480	15	21
3 PH	550 - 600	20	22


FAN: -FBO (D1000) 30"

DUCT LOCATION

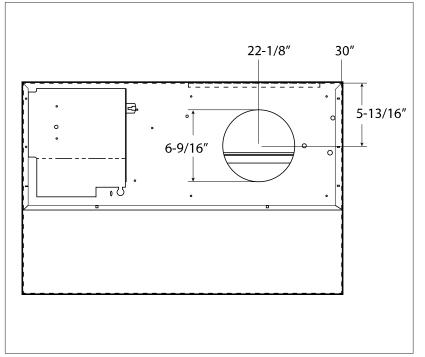

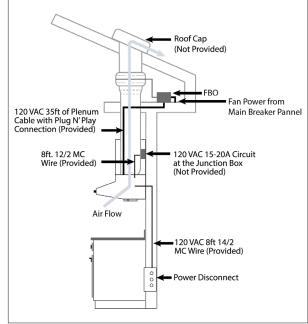

TOP DISCHARGING MOUNTING BRACKET (D1000-BPSI)

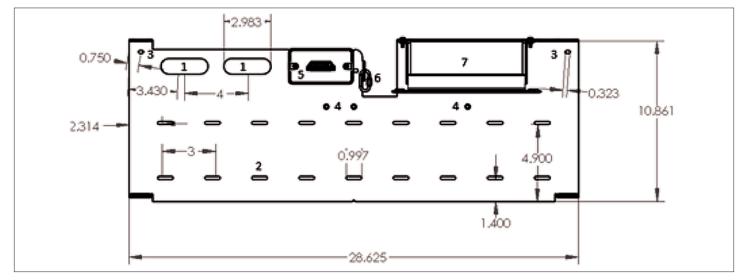




SAMPLE EXHAUST LAYOUT



ALARM: INTEGRATED TO D1000

ALARM LOCATION

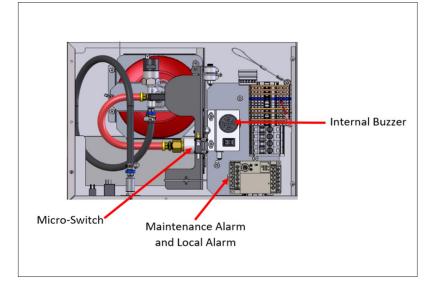


INTERNAL BUZZER SPECIFICATIONS

Туре	Audible
Decibels	90
Location	Top center of main unit
Activates upon	Tank discharge hose disconnected, low pressure in tank, or high temp fault (190° F at hood)

MAINTENANCE ALARM SPECIFICATIONS

Туре	Dry Contact	
Type of Contacts	Com / NO	
Contact Amperage	5 Amps	
Location	PLC contacts C0 and Y0	
Activates upon	Tank discharge hose disconnected, low pressure in tank, or high temp fault (190° F at hood)	

MICRO-SWITCH LAYOUT

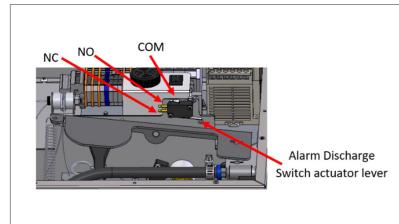

LOCAL ALARM SPECIFICATIONS

Туре	Dry Contact
Type of Contacts	Com / NO
Contact Amperage	5 Amps
Location	PLC contacts C1 and Y1
Activates upon	Low pressure in tank, and high temp fault (190° F at hood)

MICRO-SWITCH SPECIFICATIONS


Туре	Dry Contact
Type of Contacts	Com / NO / NC
Contact Amperage	15 Amps
Location	Above tank actuation paddle
Activates upon	Mechanical discharge of the tank





SUPPRESSION TANK: -TANK-FC/SA (D1000)

UNIT DIMENSIONS

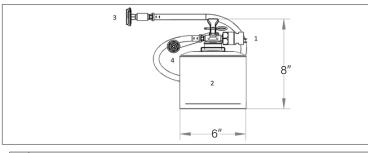


	1	Tank is Equipped with a Pressure Switch which opens on discharge.		
	2	Tank is of Stainless Steel Construction.		
	3	Visual Pressure Gauge.		
ſ	4	Discharge Hose with Quick Connect fitting attached.		


NOZZLE PLACEMENT (PRE-INSTALLED IN HOOD)

FC SPECIFICATIONS

Туре	Self Contained Fire Suppression System
Compliance	UL-1995
Mounting Configuration	Integral to the hood
Weight	9.4 lbs
Vessel	Stainless Steel
Chemical Type	Amerex 660
Volume	1300 mL
Chemical Weight	2.2 lbs
Pressure (PSI) +-8%	102 PSI
Height	8 in
Width	6 in

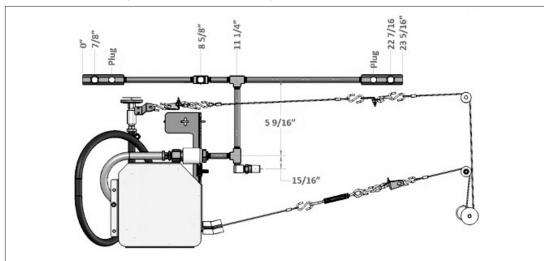

TANK LOCATION

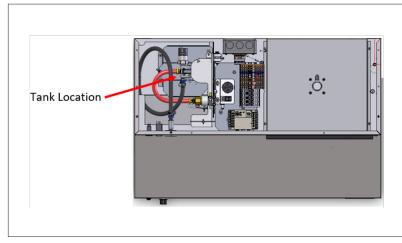

SA SPECIFICATIONS

Туре	Self Contained Fire Suppression System	
Compliance	UL-1995 Integral to the hood	
Mounting Configuration		
Weight	9.4 lbs	
Vessel	Stainless Steel	
Chemical Type	Amerex 660	
Volume	1300 mL	
Chemical Weight	2.2 lbs	
Pressure (PSI) +-8%	Charge to 102 PSI on site	
Height	8 in	
Width	6 in	