# FIRE PROTECTION

# NLAR SUBMITTAL DATA SKU: D1030-D-IF-DRD

**30" PRE-ENGINEERED RANGE HOOD** 

### **BASE MODEL: D1030-D-IF**

Job Name:		Date:	N	/lark:	
Reference:	Unit Location:		F	Prepared By:	
Engineer:	Contractor:		A	Approval:	
Expected Job Date:		Notes:			
Top Discharging External Fans:	Integral Fans: 🗌 <b>F</b> - Recirculating 🗌 <b>R</b> - Rear Discharging Top Discharging External Fans: 🗌 <b>FBO</b> - Fan by Others Module 🛛 <b>IF</b> - Inline Fan 🗌 <b>RF</b> - Roof Mounted Fan 🗌 <b>WF</b> - Wall Mounted Fan				
ADA: ADA Fan/Light Control			D1030-TC-D: Top C		
CLBX: ClockBox	Creatify Calary		MACM: Make-Up A		
<ul> <li>CC: Custom Color – (Stainless Standard)</li> <li>TANK-TEST: Test Tank</li> </ul>	Specify Color:		LSC: Limiting Speed		
MPK: Manual Pull Station		CLBX-PRO: ClockBox Pro with integrated ADA STROBE: Horn and Light Strobe Alarm			
RANGE FUEL SOURCE DISCONNECT OPTIC					
<b>G:</b> 3/4" NPT Natural Gas (DED Needed if	•			(includes 3/4" NPT Natural Gas and Electric) -	
to be Controlled on a Gas Range)			O 14-50R, 22	0VAC O 5-20R, 120VAC	
E: Electric -			ORD: Dual Receptad	cle -	
O 14-50R, 220VAC O 6-20R, 220	VAC		O 6-20R, 220	VAC O 5-15R, 120VAC O 5-20R, 120VAC	
O 10-50R, 2 20VAC O	5-20R, 120VAC				
O 5-15R, 120VAC					
ELECTRIC NEMA (RECEPTACLE) OPTIONS					
		F		G	
14-50R 10	-50R 6-2	20R	5-15R	5-20R	
220VAC 50AMP 220VA	C 50AMP 220VAC	20AMP	120VAC 15AMP	120VAC 20AMP	
			Cont	tact factory for any special circumstances	

#### REQUIREMENTS

#### Hood shall:

FN

- Be D1000 Series by DENLAR Fire Protection
- Be wall mounted so that the bottom of the mounting bracket sits 24" to 30" above the range
- Be of stainless-steel construction (#18 & #20 GA, polished 304) with no sharp edges and brushed finish
- Have factory installed fire suppression system
- Have 212° F degree fusible link (30") which will activate the mechanical fire suppression system
- Have wet chemical extinguishing agent: Low PH Amerex 660 (pressurized potassium citrate / potassium acetate mix)
- Have centrifugal fan with air delivery

- Be ETL listed, tested to UL300A standard
- Fan motor shall be permanently lubricated and meet UL507 standard
- Include a power disconnect for gas and/or electric appliances, deactivated at suppression system discharge
- Automatically disconnect range element once a certain pre-set temperature is reached or under particular predefined events or conditions
- Unit shall have multiple alarm contacts pre-installed (local, remote and trouble alarms) and an audible buzzer
- Lighting shall be by LED bulb







TRE PROTECTION DENLARHOODS.COM

DL1228A 3/24



### **BASE MODEL: D1030-D-IF**




#### **GENERAL FEATURES**


- ETL/CSA listed
- 304 Brushed Stainless Steel
- Fail-Safe mechanical actuation
- Two step pre-suppression
- Plenum nozzle
- Main power switch and reset switch
- Service switch

- Pressure switch
- Pressure gauge
- Temperature switches
- Hard wired fuel source disconnect
- Dry alarm contacts
- On board diagnostics
- Status LED

- Trouble signal
- Service key
- Audible buzzer (90db)
- LED bulb
- Grease baffle with drip tray

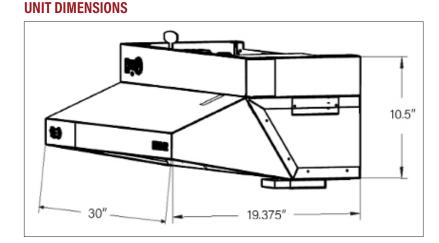

#### **REQUIRED FOR ALL MODELS**

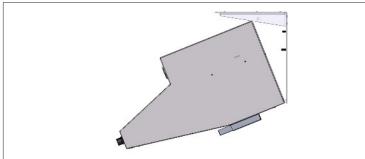

The main unit requires clearance to tilt to a 45° degree angle for maintenance purposes



#### SPECIFICATIONS Compliance

Compliance	UL300A, NSF, UL507	
Weight	53.4 lbs	
Mounting Configuration	Wall 24" - 30"	
Min / Max Install Height Above Top of Residentail Range / Cook Top		
Voltage	120 AC	
Phase	1	
Hz	60 Hz	
Amps	3.15 Amps	
Circuit Breaker Size	15-20 Amps	
Operating Current	2.4 Amps	
Fan Operating Current	2.24 Amps	
Output Operating Current	0.25 to 0.5 Amps	
Input Wiring	Power Cord	
Output Wiring	14/2 MC Wire	
Fan Type	Inline Fan (Fan is External)	
МОСР	15 Amps	
Duct Type	See Local Codes	
Fire Control	Programmable Logic Controller	
Tank Type	Stainless Steel	
Tank Pressure	102+-8% Psi	
Tank Volume	1300 mL	
Suppression Agent	Low pH Wet Chemical Amerex 660	
No. of Nozzles / Spray	5 / 60 Degree Conical	
Protection Device / Limit	3 Globe Links / 212°F	








DL1228A 3/24




### **BASE MODEL: D1030-D-IF**

#### **NOZZLE PLACEMENT**

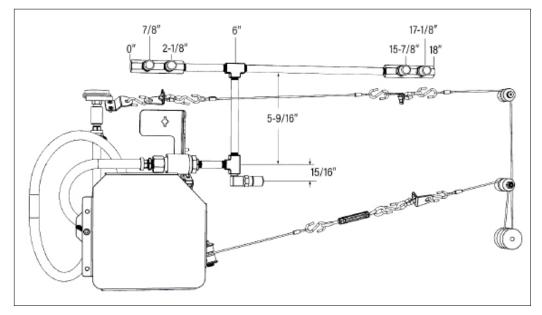

#### **TOP DUCTED EXHAUST**

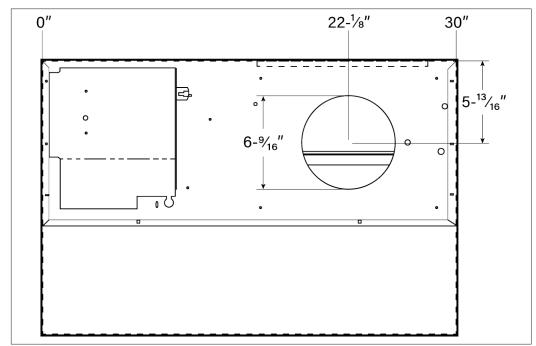






### DENLAR FIRE PROTECTION

# **DUAL RECEPTACLE POWER SOURCE DISCONNECT: -DRD (D1000)**


#### **RECEPTACLE DIMENSIONS**

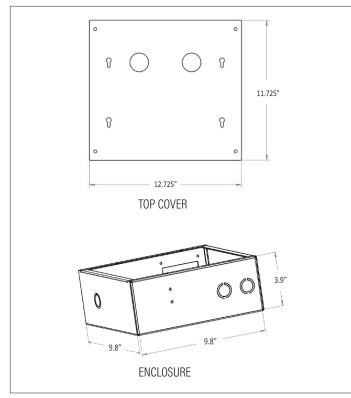

#### **SPECIFICATIONS**

Models	-DRD 6-20	-DRD 5-20	-DRD 5-15	
NEMA	6-20R	5-20R	5-15R	
Output Volts	220 AC	120 AC	120 AC	
Output Current	20 Amps	20 Amps	15 Amps	
Coil Voltage		120 AC		
Phase	1			
Material	Galvenized 60 Hz 0.5 Amps 5 X 20mm cartridge irrent 0.25 Amps			
Frequency				
Fuse				
Fuse Type				
Operating Current				

#### **SCHEMATIC**

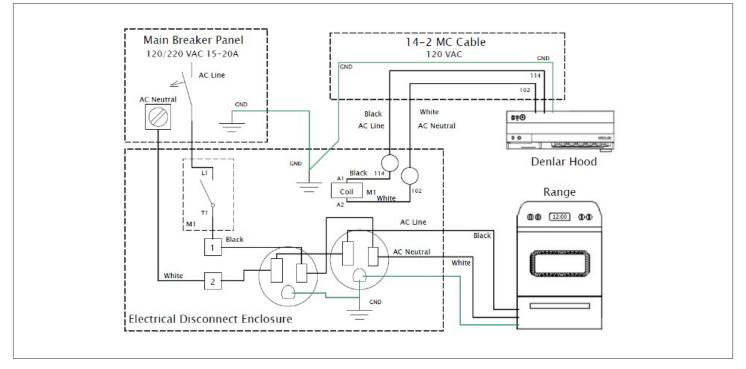




### DENLAR FIRE PROTECTION

# FAN: -D-IF (D1000) 30"

#### STANDARD INLINE DIMENSIONS

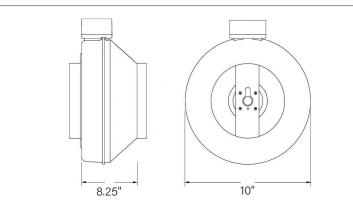


	D1000-BPSI Layout				
1	Cut-outs for Wire Entry				
2	Mounting Holes				
3	Top Mounting Holes				
4	1/4-20 Studs for Securing Hoods to D1000-BPSI				
5	Handy box for Power In and Power Out				
6	Quick Link Safety Cable Holder				

- Collar to Attach Duct Work (7" Dia. X 1" Height) (A Minimum of 6" length of 7" Dia. Duct is required before
- connecting an Increaser/Adapter)

### SPECIFICATIONS

Style	Inline
Туре	Ducted
Weight	10.5 lbs
Operating Current	1.8 Amps
Voltage	120 AC
Phase	1
Frequency	60 Hz
CFM + -2.5% (Low-High)	283 - 474
Pressure (In Water)	-0.230.61
dBA (Low-High)	57 - 69
Hood Outlet (Length-Height)	7 in (Dia)
Duct	35 ft
Fan Inlet	10 in (Dia)
Fan Outlet	10 in (Dia)
Control	Electronic Control Module (ECM)
Speeds	Variable

#### **TOP DISCHARGING MOUNTING BRACKET (D1000-BPSI)**

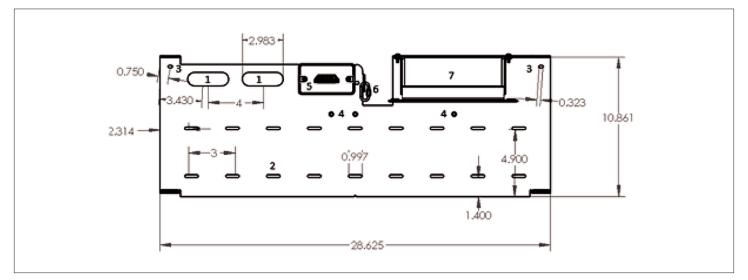





### DENLAR FIRE PROTECTION

# FAN: -D-IF (D1000) 30"

#### **DUCT LOCATION**

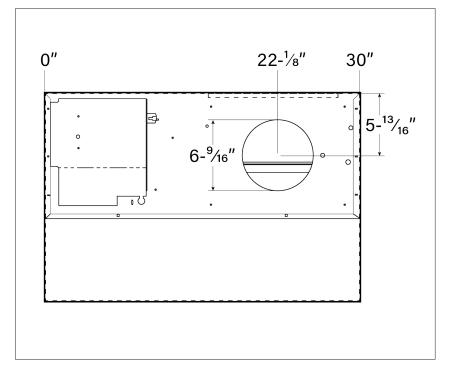

#### SAMPLE EXHAUST LAYOUT

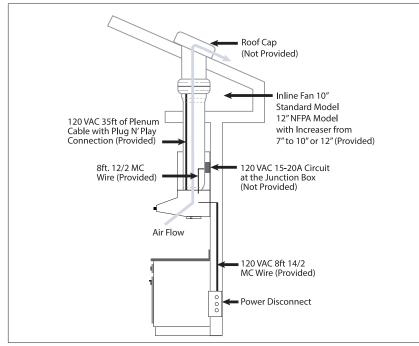






### **ALARM: INTEGRATED TO D1000**

#### **ALARM LOCATION**

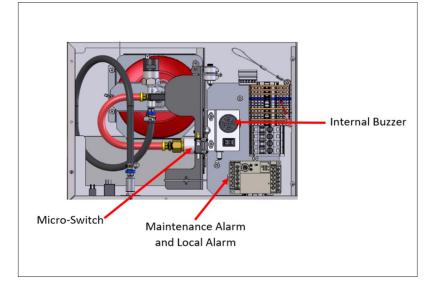


#### **INTERNAL BUZZER SPECIFICATIONS**

Туре	Audible
Decibels	90
Location	Top center of main unit
Activates upon	Tank discharge hose disconnected, low pressure in tank, or high temp fault (190° F at hood)

#### **MAINTENANCE ALARM SPECIFICATIONS**

Туре	Dry Contact
Type of Contacts	Com / NO
Contact Amperage	5 Amps
Location	PLC contacts C0 and Y0
Activates upon	Tank discharge hose disconnected, low pressure in tank, or high temp fault (190° F at hood)

#### **MICRO-SWITCH LAYOUT**

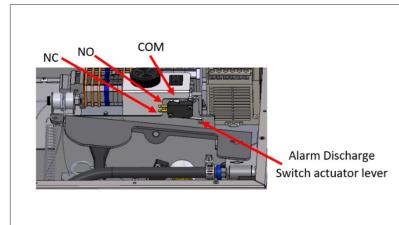

#### LOCAL ALARM SPECIFICATIONS

Туре	Dry Contact
Type of Contacts	Com / NO
Contact Amperage	5 Amps
Location	PLC contacts C1 and Y1
Activates upon	Low pressure in tank, and high temp fault (190° F at hood)

#### **MICRO-SWITCH SPECIFICATIONS**


Туре	Dry Contact	
Type of Contacts	Com / NO / NC	
Contact Amperage	15 Amps	
Location	Above tank actuation paddle	
Activates upon	Mechanical discharge of the tank	





### **SUPPRESSION TANK: -TANK-FC/SA (D1000)**

#### **UNIT DIMENSIONS**

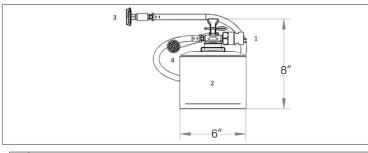


	1	Tank is Equipped with a Pressure Switch which opens on discharge			
	2	Tank is of Stainless Steel Construction.			
	3	3 Visual Pressure Gauge.			
ſ	4	Discharge Hose with Quick Connect fitting attached.			


#### **NOZZLE PLACEMENT (PRE-INSTALLED IN HOOD)**

#### **FC SPECIFICATIONS**

Туре	Self Contained Fire Suppression System
Compliance	UL-1995
Mounting Configuration	Integral to the hood
Weight	9.4 lbs
Vessel	Stainless Steel
Chemical Type	Amerex 660
Volume	1300 mL
Chemical Weight	2.2 lbs
Pressure (PSI) +-8%	102 PSI
Height	8 in
Width	6 in

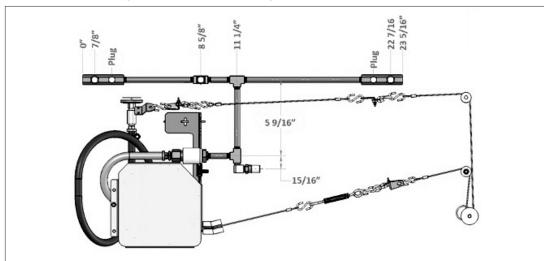

#### **TANK LOCATION**

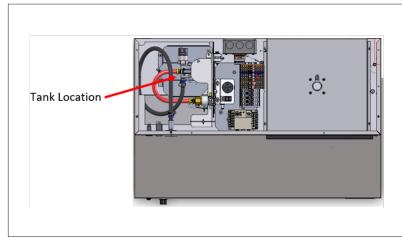

#### SA SPECIFICATIONS

Туре	Self Contained Fire Suppression System	
Compliance	UL-1995	
Mounting Configuration	Integral to the hood	
Weight	9.4 lbs	
Vessel	Stainless Steel	
Chemical Type	Amerex 660	
Volume	1300 mL	
Chemical Weight	2.2 lbs	
Pressure (PSI) +-8%	Charge to 102 PSI on site	
Height	8 in	
Width	6 in	