

# SUBMITTAL DATA SKU: D1036-D-RF-DRD

**36" PRE-ENGINEERED RANGE HOOD** 

## **BASE MODEL: D1036-D-RF**

Job Name:		Date:		Mark:
Reference:	Unit Location:			Prepared By:
Engineer:	_ Contractor:			Approval:
Expected Job Date:		_ Notes:		
MODEL FAN OPTIONS Integral Fans: F - Recirculating R - Rear		IF Julius For		
Top Discharging External Fans: FBO - Fan by SELECT OPTIONAL ACCESSORIES				
ADA: ADA Fan/Light Control			MACM: Make-Up	
			LSC: Limiting Spe	
CC: Custom Color – (Stainless Standard TANK-TEST: Test Tank	I) Specify Color:	Li		box Pro with integrated ADA
			PD4X: Power Dist	d Light Strobe Alarm
MPK: Manual Pull Station			PD4X: Power Dist	Inducion Box
D1036-TC-D: Top Cover RANGE FUEL SOURCE DISCONNECT OPTI	ONS (CHECK APPROF	PRIATE RECEPTA	CLF)	
<b>G:</b> 3/4" NPT Natural Gas (DED Needed i	•			t (includes 3/4" NPT Natural Gas and Electric) -
to be Controlled on a Gas Range)			O 14-50R, 2	220VAC O 5-20R, 120VAC
E: Electric -		X	DRD: Dual Recept	acle -
O 14-50R, 220VAC O 6-20R, 22	0VAC		O 6-20R, 22	20VAC O 5-15R, 120VAC O 5-20R, 120VAC
O 10-50R, 220VAC O 5-20R, 120	OVAC			
O 5-15R, 120VAC				
ELECTRIC NEMA (RECEPTACLE) OPTIONS	5			
			G	G
14-50R 1	0-50R	6-20R	5-15R	5-20R
220VAC 50AMP 220V/	AC 50AMP 220V	AC 20AMP	120VAC 15AMF	2 120VAC 20AMP
			Co	ntact factory for any special circumstances

### REQUIREMENTS

### Hood shall:

- Be D1000 Series by DENLAR Fire Protection
- Be wall mounted so that the bottom of the mounting bracket sits 30" to 36" above the range
- Be of stainless-steel construction (#18 & #20 GA, polished 304) with no sharp edges and brushed finish
- Have factory installed fire suppression system
- Have 280° F degree fusible link (36") which will activate the mechanical fire suppression system
- Have wet chemical extinguishing agent: Low PH Amerex 660 (pressurized potassium citrate / potassium acetate mix)
- Have centrifugal fan with air delivery



- Be ETL listed, tested to UL300A standard
- Fan motor shall be permanently lubricated and meet UL507 standard
- Include a power disconnect for gas and/or electric appliances, deactivated at suppression system discharge
- Automatically disconnect range element once a certain preset temperature is reached or under particular predefined events or conditions
- Unit shall have multiple alarm contacts pre-installed (local, remote and trouble alarms) and an audible buzzer
- Lighting shall be LED bulb







DL1198A 2/24



## **BASE MODEL: D1036-D-RF**




#### **GENERAL FEATURES**


- ETL/CSA listed
- 304 Brushed Stainless Steel
- Fail-Safe mechanical actuation
- Two step pre-suppression
- Plenum nozzle
- Main power switch and reset switch
- Service switch

- Pressure switch
- Pressure gauge
- Temperature switches
- Hard wired fuel source disconnect
- Dry alarm contacts
- On board diagnostics
- Status LED

- Trouble signal
- Service key
- Audible buzzer (90db)
- LED bulb
- Grease baffle with drip tray

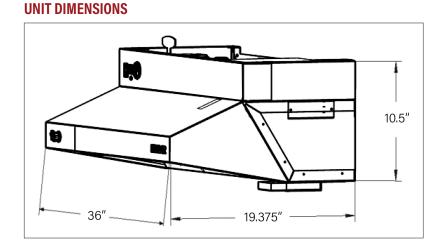

#### **REQUIRED FOR ALL MODELS**

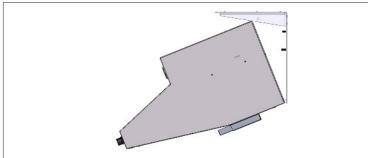

The main unit requires clearance to tilt to a 45° degree angle for maintenance purposes



### SPECIFICATIONS Compliance

Compliance	UL300A, NSF, UL507
Weight	56.8 lbs
Min / Max Install Height Above Top of Residentail Range / Cook Top	30" - 36"
Voltage	120 AC
Phase	1
Hz	60 Hz
Amps	6.3 Amps
Circuit Breaker Size	15-20 Amps
Operating Current	4.6 Amps
Fan Operating Current	3.42 Amps
Output Operating Current	0.25 to 0.5 Amps
Input Wiring	Power Cord
Output Wiring	14/2 MC Wire
Fan Type	Roof Mounted Fan, (Fan is External)
MOCP	15 Amps
Duct Type	See Local Codes
Fire Control	Programmable Logic Controller
Tank Type	Stainless Steel
Tank Pressure	102+-8% Psi
Tank Volume	1300 mL
Suppression Agent	Low pH Wet Chemical Amerex 660
No. of Nozzles / Spray	4 / 60 Degree Conical
Protection Device / Limit	3 Globe Links / 280° F




DL1198A 2/24




## **BASE MODEL: D1036-D-RF**

### **NOZZLE PLACEMENT**

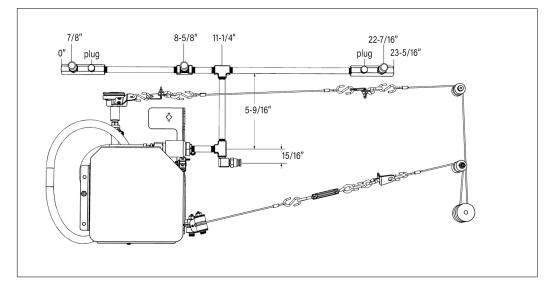

### **TOP DUCTED EXHAUST**

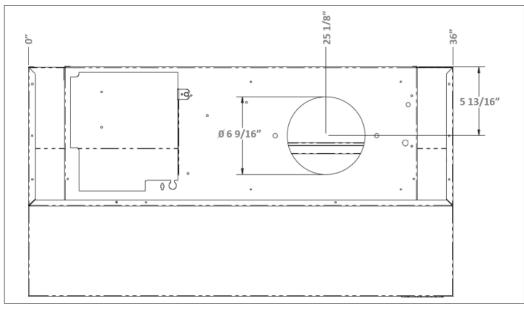






## DENLAR FIRE PROTECTION

# **DUAL RECEPTACLE POWER SOURCE DISCONNECT: -DRD (D1000)**


### **RECEPTACLE DIMENSIONS**

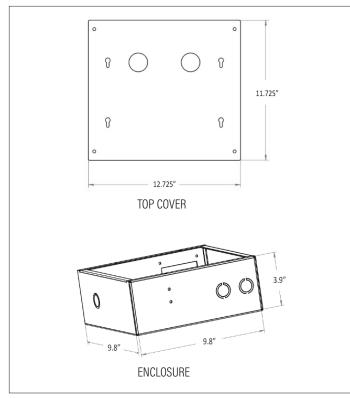

### **SPECIFICATIONS**

Models	-DRD 6-20	-DRD 5-20	-DRD 5-15	
NEMA	6-20R	5-20R	5-15R	
Output Volts	220 AC	120 AC	120 AC	
Output Current	20 Amps	20 Amps	15 Amps	
Coil Voltage		120 AC		
Phase		1		
Material	Galvenized			
Frequency		60 Hz		
<b>Fuse</b> 0.5 A		0.5 Amps		
Fuse Type	5 X 20mm cartridge		ge	
Operating Current		0.25 Amps		

#### **SCHEMATIC**

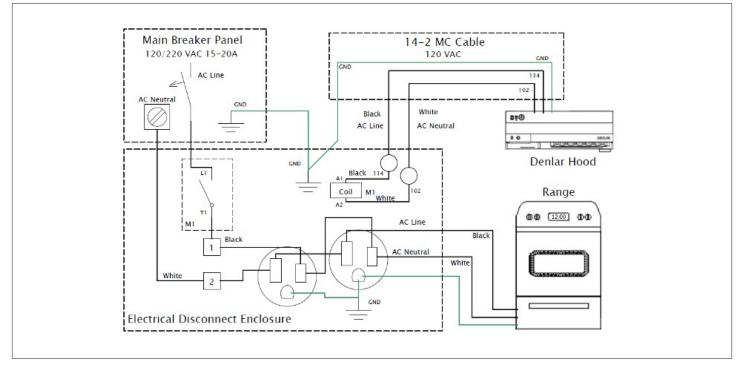






## FAN: -D-RF (D1000) 36"

### **STANDARD ROOF MOUNT DIMENSIONS**

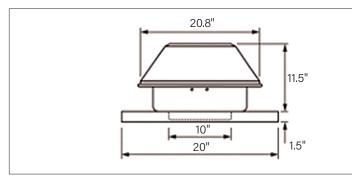


_					
	D1000-BPSI Layout				
	1 Cut-outs for Wire Entry				
	2 Mounting Holes				
	3	3 Top Mounting Holes			
	4	1/4-20 Studs for Securing Hoods to D1000-BPSI			
	5 Handy box for Power In and Power Out				
	6 Quick Link Safety Cable Holder				
Γ		Collar to Attach Duct Work (7" Dia. X 1" Height) (A Minimum			

- of 6" length of 7" Dia. Duct is required before connecting an Increaser/Adapter) 7

## **SPECIFICATIONS**

Style	Roof Mount
Туре	Roof w/ Curb Adapter (without physical curb)
Weight	35 lbs
Operating Current	4 Amps
Voltage	120 AC
Phase	1
Frequency	60 Hz
CFM + -2.5% (Low-High)	357 - 499
Pressure (In Water)	-0.40.84
dBA (Low-High)	61 - 73
Hood Outlet (Length-Height)	7 in (Dia)
Duct	50 ft
Fan Inlet	10 in (Dia)
Fan Outlet	20 <sup>13</sup> / <sub>16</sub> in (Dia)
Control	Electronic Control Module (ECM)
Speeds	Variable

### **TOP DISCHARGING MOUNTING BRACKET (D1000-BPSI)**

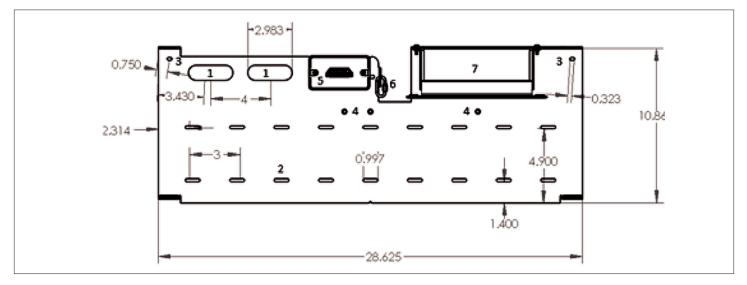





## **DENLAR** FIRE PROTECTION

# FAN: -D-RF (D1000) 36"

### **DUCT LOCATION**

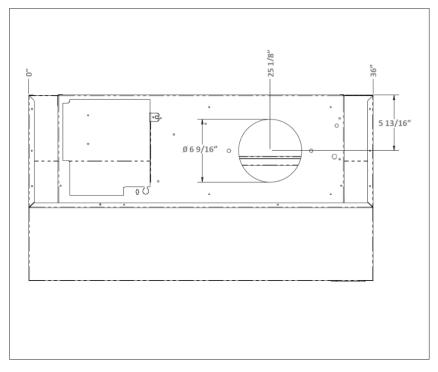

### SAMPLE EXHAUST LAYOUT

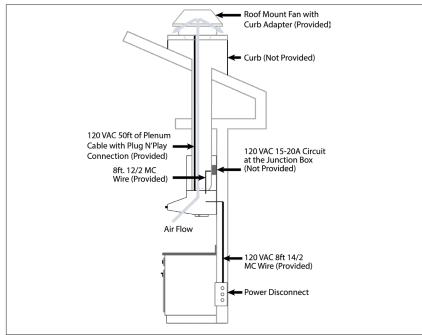






## **ALARM: INTEGRATED TO D1000**

### **ALARM LOCATION**

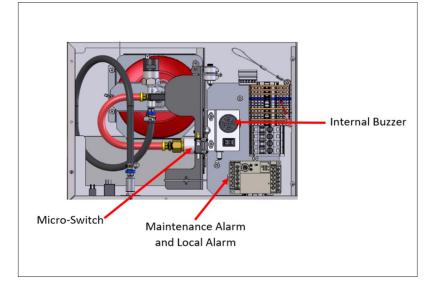


### **INTERNAL BUZZER SPECIFICATIONS**

Туре	Audible	
Decibels	90	
Location	Top center of main unit	
Activates upon	Tank discharge hose disconnected, low pressure in tank, or high temp fault (190° F at hood)	

### **MAINTENANCE ALARM SPECIFICATIONS**

Туре	Dry Contact
Type of Contacts	Com / NO
Contact Amperage	5 Amps
Location	PLC contacts C0 and Y0
Activates upon	Tank discharge hose disconnected, low pressure in tank, or high temp fault (190° F at hood)

### **MICRO-SWITCH LAYOUT**

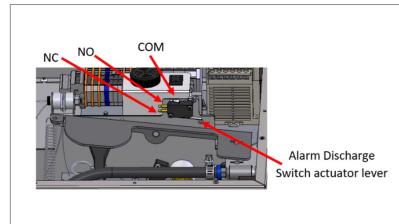

### LOCAL ALARM SPECIFICATIONS

Туре	Dry Contact
Type of Contacts	Com / NO
Contact Amperage	5 Amps
Location	PLC contacts C1 and Y1
Activates upon	Low pressure in tank, and high temp fault (190° F at hood)

### **MICRO-SWITCH SPECIFICATIONS**


Туре	Dry Contact
Type of Contacts	Com / NO / NC
Contact Amperage	15 Amps
Location	Above tank actuation paddle
Activates upon	Mechanical discharge of the tank





# **SUPPRESSION TANK: -TANK-FC/SA (D1000)**

### **UNIT DIMENSIONS**

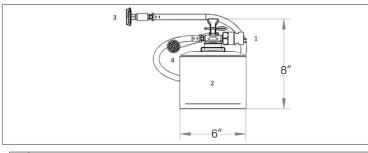


	1	Tank is Equipped with a Pressure Switch which opens on discharge.		
	2	2 Tank is of Stainless Steel Construction.		
3 Visual Pressure Gauge.		Visual Pressure Gauge.		
ſ	4	Discharge Hose with Quick Connect fitting attached.		


### **NOZZLE PLACEMENT (PRE-INSTALLED IN HOOD)**

### **FC SPECIFICATIONS**

Туре	Self Contained Fire Suppression System
Compliance	UL-1995
Mounting Configuration	Integral to the hood
Weight	9.4 lbs
Vessel	Stainless Steel
Chemical Type	Amerex 660
Volume	1300 mL
Chemical Weight	2.2 lbs
Pressure (PSI) +-8%	102 PSI
Height	8 in
Width	6 in

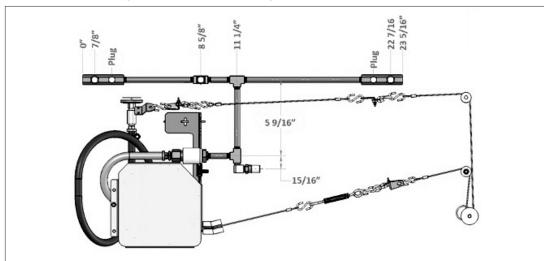

### **TANK LOCATION**

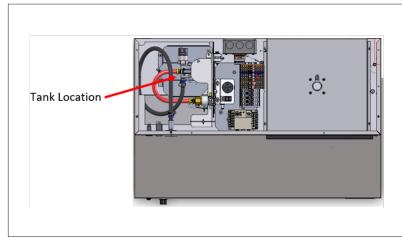

### SA SPECIFICATIONS

Туре	Self Contained Fire Suppression System	
Compliance	UL-1995	
Mounting Configuration	Integral to the hood	
Weight	9.4 lbs	
Vessel	Stainless Steel	
Chemical Type	Amerex 660	
Volume	1300 mL	
Chemical Weight	2.2 lbs	
Pressure (PSI) +-8%	Charge to 102 PSI on site	
Height	8 in	
Width	6 in	